

GasQuip



SF6 Mass Flow Meter

Operating Manual

Model GQ-SENTRY-V2

Contact Information:

GasQuip LLC Headquarters

11400 State Highway 30, Suite 404

College Station TX 77845

Sales@gasquip.com | 713.955.3177



This device comes with a NIST traceable calibration certificate.



This device conforms to the European Union's Restriction of Use of Hazardous Substances in Electrical and Electronic Equipment (RoHS) Directive 2011/65/EU.



This device complies with the requirements of the Low Voltage Directive 2014/35/EU and the EMC Directive 2014/30/EU and carries the CE Marking accordingly.




This device complies with the requirements of the European Union's Waste Electrical & Electronic Equipment (WEEE) Directive 2002/96/EC


Contents

Screen Layout.....	4
Safety Precautions.....	6
General Safety	6
Device Safety	6
Operation	7
Setup.....	7
Device Preparation	7
Filling Into GIE.....	7
Wrapping up.....	8
Specifications.....	9
Maintenance	10
Calibration.....	10
2 Year Limited Warranty	11

Screen Layout

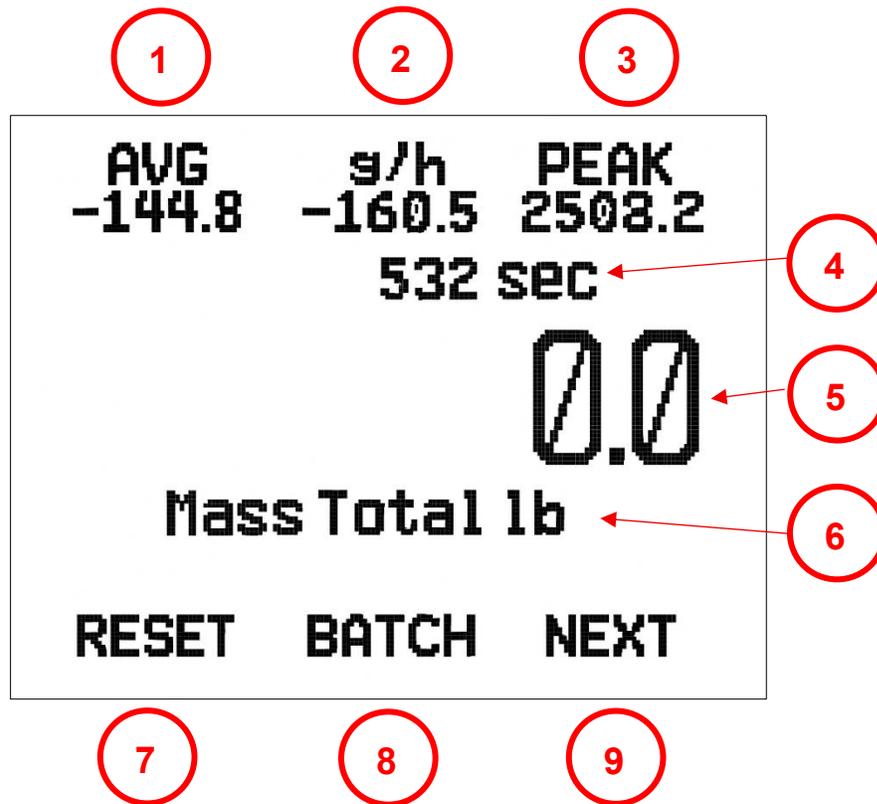

1. Average flow
2. Current Flow (Press Button for Units)
3. Peak Flow
4. Elapsed Time
5. Totalized Mass Readout
6. Mass Units (Changed By Pressing #2 Button)
7. Reset Totalizer
8. Batch
9. Next Screen (Press Button for Flow, Again for Settings)

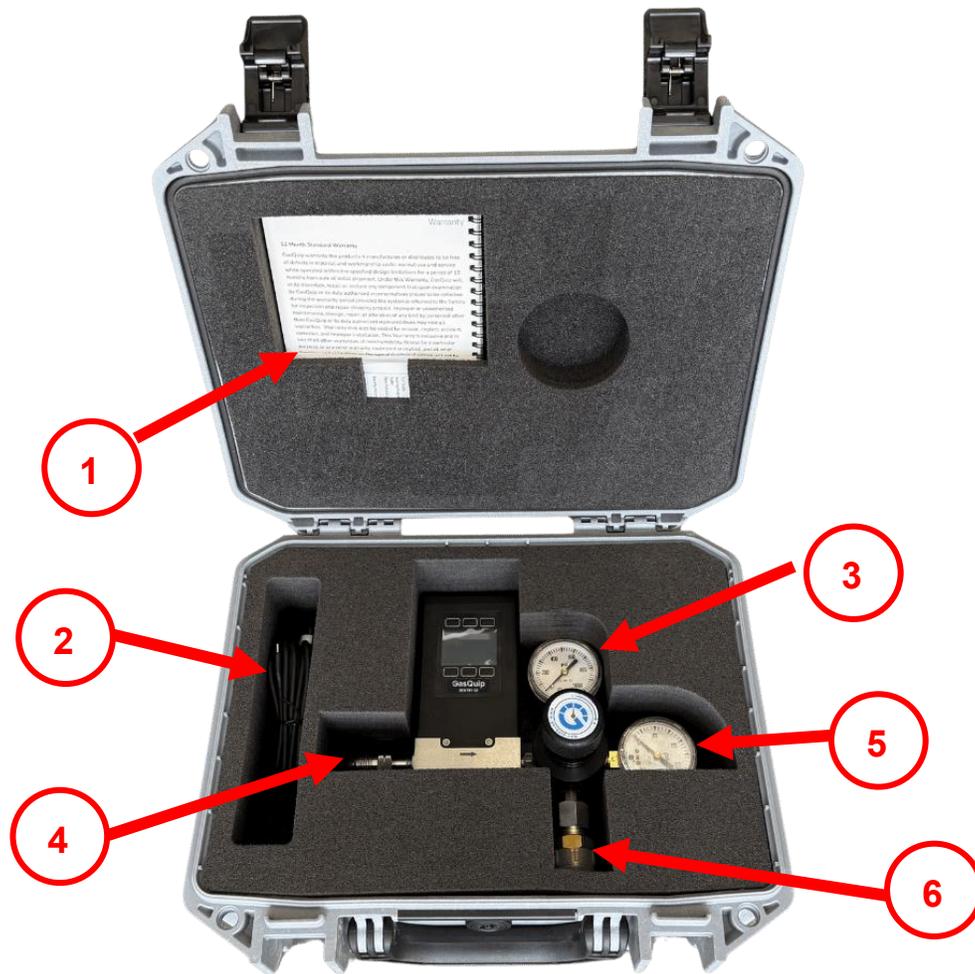

1. Instruction Manual & Calibration Certificate
2. Power Cord
3. Input Gauge
4. CGA-590 Cylinder Connection
5. Output Gauge
6. DN8 Male Connection

Safety Precautions

General Safety

- **Always** position SF6 gas cylinder in an upright position, secured to a permanent structure with a safety chain or strap.
- **Always** use safety shoes when operating Sentry around electrical equipment
- **Always** use safety goggles around high pressure gas cylinders and electrical equipment
- **Only** properly trained personnel should carry out maintenance and repair work on pressure gas filled equipment.

Device Safety

- **Only** operate the device in sufficiently large and ventilated compartments (room volume > 100 m³) so that the admissible SF6 concentration in ambient air is not exceeded in case of leakages incurring suddenly.
- For operation in smaller compartments SF6 warning devices **must** be available as well as the possibility to leave the compartment quickly.
- The Sentry is designed for use with pure SF6 gas. **Do not** use device with any other gas besides 99.9% Sulfur Hexafluoride.

Operation

Setup

1. Connect the Sentry to the SF6 gas cylinder by using the CGA-590 nut. Snuggly tighten the nut with a wrench.
2. Connect the DN8 hose to the male DN8 connection on the output of the regulator. Do not connect the hose to the switchgear gas connection yet.
3. Plug in power cord to the top of the sentry display (micro–USB Port). Plug in opposite side power brick into a 120V outlet.

Device Preparation

1. Turn regulator counterclockwise to close valve.
2. Open SF6 bottle valve completely by turning cylinder knob counterclockwise.
3. Set regulator output to pressure specified by switchgear manufacturer. Slowly turn regulator knob clockwise and watch output pressure gauge until the specified fill pressure is met.

Filling Into GIE

1. Hook up the hose to the switchgear.
2. Open the valve on the gas compartment on the GIE to allow gas to begin flowing into GIE
3. Monitor the pressure on the breaker pressure gauge until the manufacturers specified filling pressure is reached.
4. Once specified filling pressure is reached, close the valve on the GIE gas reservoir
5. Close the valve on the SF6 cylinder

Wrapping up

1. Turn regulator counterclockwise to close valve
2. Record amount of gas showing in pounds
3. Unplug power cord from outlet and sentry device
4. Disconnect hose from switchgear and Sentry
5. Disconnect Sentry from SF6 cylinder by loosening CGA-590 nut
6. Pack sentry and other power cables into storage case

Specifications

Device Dimensions	10.75" x 8.75" x 4.25"
Power Supply	5V, 2.5A Micro USB
Flow Speed	.59 CV
Operating Temperature	0-60 C
Output Connection	DN8 Male (unless otherwise specified)
Case Dimension	15.4" x 13.1" x 6.2"
Accuracy	+0.01 lbs.
Weight	6 lbs.
Input Connection	CGA 590

Maintenance

Cleaning

- This device requires minimal maintenance. If necessary, the outside of the device may be cleaned with a soft dry cloth. Avoid excess moisture or solvents. If fittings have been disassembled from unit, always clear out all old teflon tape from all surfaces.

Replacement Parts

- Each part of the Sentry was designed to be replaceable in case of damage. We recommend sending all damaged units back to GasQuip headquarters to be serviced. Check the warranty page for information on what damage is covered within our policy.

Calibration

The Senry-V2 is calibrated to NIST-traceable standards at the time of manufacture. Due to the stability of the Coriolis technology, there is not a factory-recommended periodic recalibration cycle. Recalibration can be requested at the user's discretion/requirement by gasquip.com/contact-us

2 Year Limited Warranty

Notice: GasQuip LLC reserves the right to make any changes and improvements to the products described in this manual at any time and without notice. This manual is copyrighted. This document may not, in whole or in part, be copied, reproduced, translated, or converted to any electronic medium or machine-readable form, for commercial purposes, without prior written consent from the copyright holder. Note: Although we provide assistance on GasQuip LLC products both personally and through our literature, it is the complete responsibility of the user to determine the suitability of any product to their application. GasQuip LLC warrants to the original purchaser (hereinafter referred to as "Buyer") that instruments manufactured by GasQuip LLC (hereinafter referred to as "Product") shall be free from defects in materials and workmanship for the life of the Products. Under this warranty, the Products will be repaired or replaced at manufacturer's option, without charge for parts or labor when the Product is carried or shipped prepaid to the factory together with proof of purchase. The foregoing shall constitute the exclusive and sole remedy in lieu of other remedies of the Buyer for any breach by GasQuip LLC of this warranty to the maximum extent permitted by law. This warranty does not apply to any Product which has not been installed or used in accordance with the Product operation and installation specifications provided to Buyer verbally or in writing by GasQuip LLC for the proper and normal use of the Product. Buyer agrees hereunder that GasQuip reserves the right to void any warranty, written or implied, if upon GasQuip's examination of Product shall disclose to GasQuip's satisfaction that the Product failure was due solely, or in part, to accident, misuse, neglect, abuse, alteration, improper installation, unauthorized repair or improper testing by Buyer or agent of Buyer. GasQuip LLC shall not be liable under any circumstances for indirect, special, consequential, or incidental damages in connection with, or arising out of, the sale, performance, or use of the Products covered by this warranty. GasQuip LLC does not recommend, warrant or assume responsibility for the use of the Products in life support applications or systems. GasQuip's warranties as herein above set forth shall not be enlarged, diminished or affected by, and no obligation or liability shall arise or grow out of GasQuip's rendering of technical advice in connection with Buyer's order of the Products furnished hereunder. If Product becomes obsolete, GasQuip LLC, at its own discretion, reserves the right to repair the Product with available replacement parts or upgrade the Product to a current, commercially available version of the original Product. Should upgrading the Product be deemed necessary by GasQuip, Buyer hereby agrees to pay an upgrade fee equal to seventy percent of the retail value of the replacement Product. GasQuip LLC hereunder makes no claim that replacement Products will look, function or operate in the same or similar manner as the original product. When a Product is returned to GasQuip LLC for recalibration this service is considered normal preventative maintenance. Recalibration of Product shall not be treated as a warranty service unless recalibration of Product is required as the result of repairs to Product pursuant to this Warranty. Failure of Buyer to send Product to GasQuip LLC for recalibration on a yearly basis after a period of 36 months from date of manufacture will remove any and all obligations regarding repair or replacement of Product as outlined by this Warranty to Buyer from GasQuip LLC. This Warranty is in lieu of all other relevant warranties, expressed or implied, including the implied warranty of merchantability and the implied warranty of fitness for a particular purpose, and any warranty against infringement of any patent. Continued use or possession of Products after expiration of the applicable warranty period stated above shall be conclusive evidence that the warranty is fulfilled to the full satisfaction of Buyer. GasQuip makes no warranty as to experimental, non-standard or developmental Products. Accessories purchased from GasQuip are not covered by this warranty. The product complies with the requirements of the Low Voltage Directive 2014/35/EU, the EMC Directive 2014/30/ EU and the RoHS Directive 2011/65/EU and carries the CE Marking accordingly. Contact the manufacturer for more information.